



Olsen Pavingstone Preliminary Reflectivity Test results

OLSEN PAVINGSTONE, INC.
P.O. BOX 1330
SAN JUAN CAPISTRANO, CA 92693


COLOR	Reflectivity			Emissivity	SRI = Solar Reflective Index		
	Sample 1	Sample 2	Average		5Wm ⁻² K ⁻¹	12Wm ⁻² K ⁻¹	30Wm ⁻² K ⁻¹
OLSEN PAVINGSTONE, INC.							
GREEN	0.327	0.345	0.336	0.90	36.3	36.8	37.2
RED	0.366	0.343	0.355	0.87	36.9	38.0	39.0
NATURAL GRAY	0.304	0.328	0.316	0.89	33.1	33.8	34.4
LIMESTONE TUMBLED	0.353	0.345	0.349	0.87	36.2	37.2	38.2
OLSEN BUFF TUMBLED	0.364	0.349	0.357	0.91	39.7	40.0	40.2
SANDSTONE TUMBLED	0.364	0.349	0.357	0.88	37.9	38.7	39.5
TERRA COTTA	0.344	0.320	0.332	0.90	35.8	36.3	36.7
TAN	0.355	0.343	0.349	0.89	37.4	38.1	38.7

Testing conducted by an CRRC approved Laboratory

Testing conducted on December 5, 2007

Testing conducted in accordance with ASTM C-1549 for solar reflectance

Testing conducted in accordance with ASTM C-1371 for thermal emittance

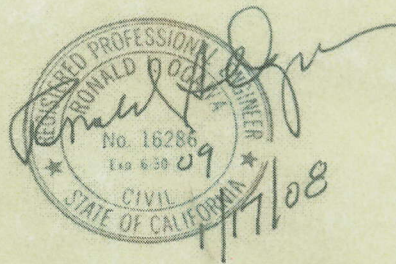

P.O. BOX 1330 SAN JUAN CAPISTRANO, CA 92693
CELL. 949.702.4864 • TEL. 949.728.0415 • FAX. 949.728.0540